
1 Phase / 1 Phase UPS Wiring Diagram

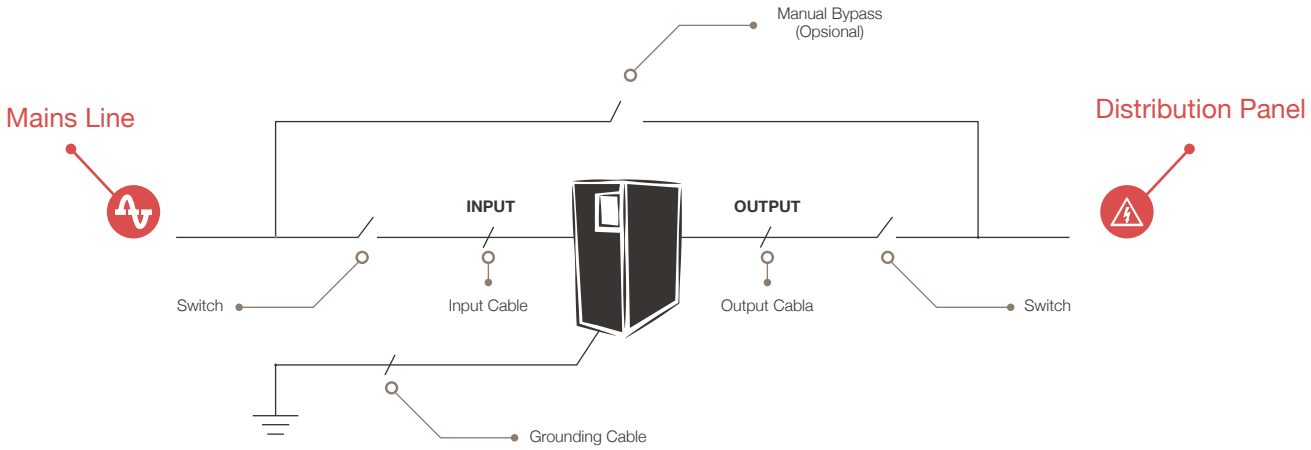

UPS Power (kVA)	Input Cable Section	Output Cable Section	Grounding Cable Section	Input / Output Switches (Circuit Breaker)
5	2x4 mm²	2x4 mm²	1x4 mm²	1x40 A
6	2x4 mm²	2x4 mm²	1x4 mm²	1x50 A
7.5	2x6 mm²	2x6 mm²	1x6 mm²	1x63 A
10	2x6 mm²	2x6 mm²	1x6 mm²	1x63 A
15	2x10 mm²	2x10 mm²	1x6 mm²	1x80 A

* **Note:** Separated grounding line should be provided for UPS

Deri OSB Arıtma Cd. No:6-A
Tuzla, İstanbul
T: 216 494 0 444
F: 216 494 3 000
info@necron.com.tr

necron energy